
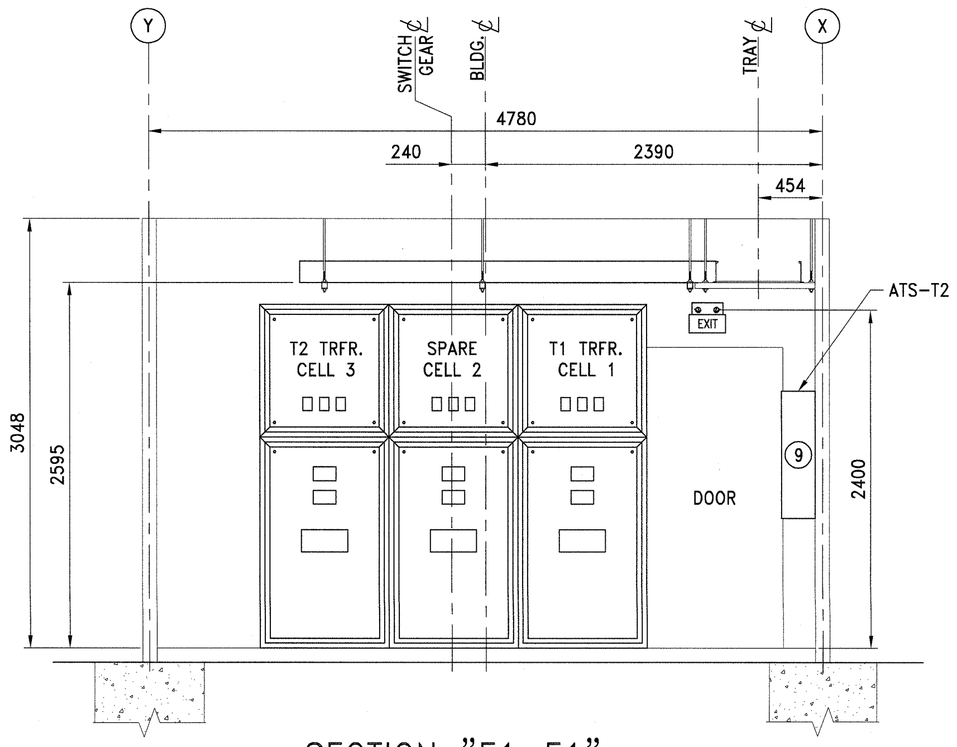



SECTION "E1-E1"

SCALE: 1:30

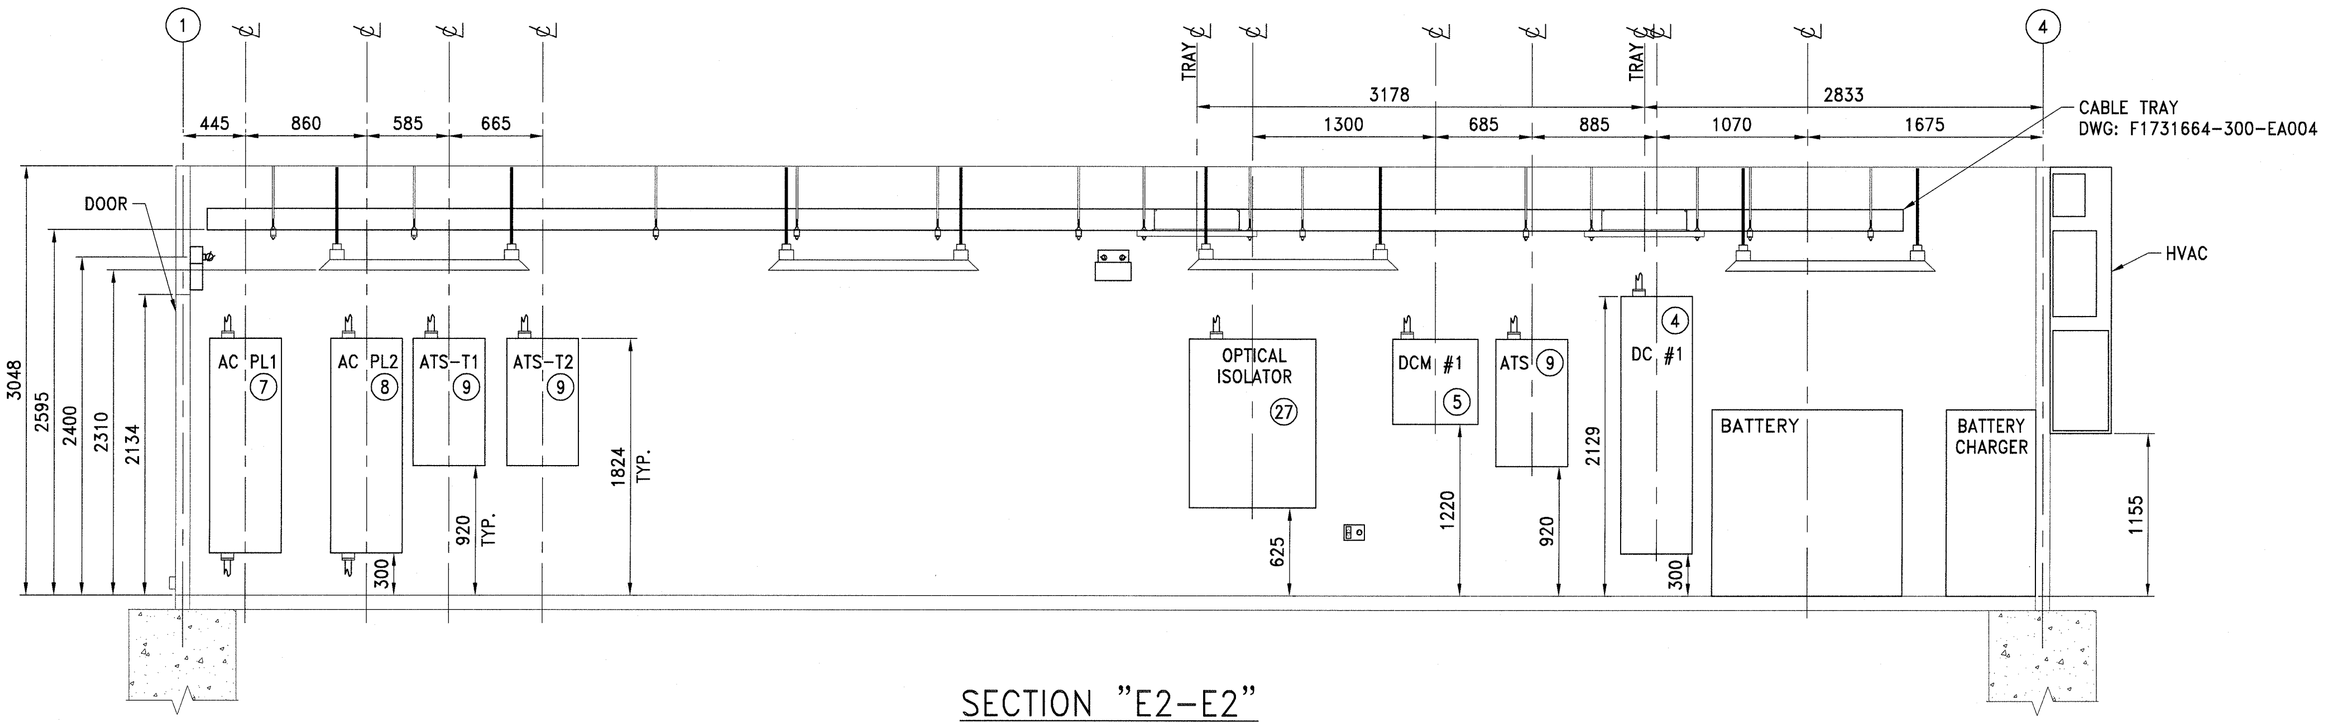

SECTION "E2-E2"

SCALE: 1:30

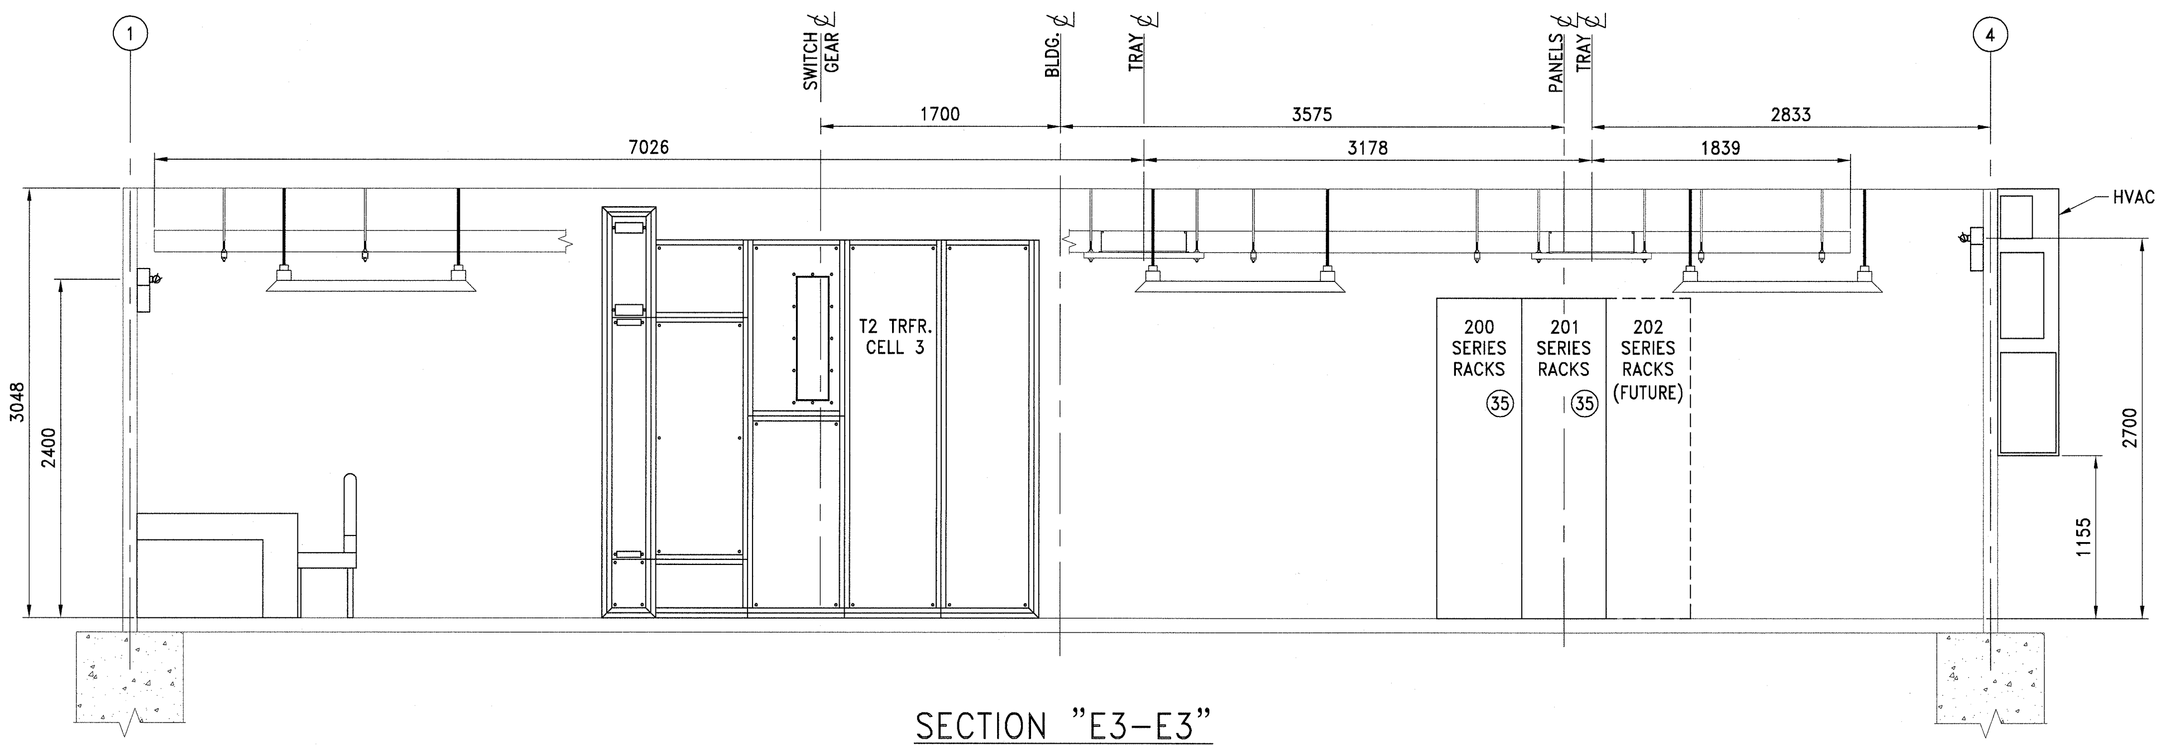

SECTION "E3-E3"

SCALE: 1:30

NOTES:

1. THE BUILDING MANUFACTURER TO PROVIDE PLATFORM SUPPORTING BRACKETS THE DEPTH OF PERIMETER BEAM, OR EQUIVALENT.
2. THE BUILDING MANUFACTURER TO PROVIDE RIGID PVC PIPE CONNECTION TO HVAC DRAIN OUTLET DOWN THE SIDE OF BUILDING.
3. ALL WALL MOUNTED RECEPT. TO BE INSTALLED 450MM ABOVE FINISHED FLOOR UNLESS OTHERWISE NOTED. LIGHTING SWITCHES TO BE MOUNTED 1370MM FINISHED FLOOR CENTERLINE OF SWITCH LOCATED 100MM FROM DOOR FRAME.
4. FOR DC-MONITORING CABINETS WIRING USE 2" FR PVC PIPE.
5. REQUIRED ONLY FOR STATIONS WITH DG.

PROFESSIONALS:

N°	DATE	TRANSMISSION	BY ENG

THE S.M. GROUP INTERNATIONAL INC.
6205B Airport rd, Suite 205, Mississauga (Ontario) L4V 1E3
Tel.: 905 677.9009 / Fax.: 905 677.9014
www.groupesm.com

RELEASED FOR CONSTRUCTION

STAMP:

LICENSED PROFESSIONAL ENGINEER
Y.Lessard
100128893
PROVINCE OF ONTARIO

CLIENT:

PROJECT:

MCMASTER UNIVERSITY-NF91

TITLE:

13.8kV AREA E-HOUSE SECTIONS VIEW ELECTRICAL ARRANGEMENT

PREPARED BY: M.GUAY	DATE: 2018/07/15
DRAWN BY: M.GUAY	SCALE: 1:30
VERIFIED BY: M.LAROCQUE	DISCIPLINE: ELECTRICAL ARRANGEMENT
APPROVED BY: Y.LESSARD	CAD FILE NAME: F1731664-300-EA003.dwg

PROJECT No:	LOT:	DWG. #	REV:	PAGE:
F1731664	300	EA003	00	

A1